

EIB/KNX 12-fold 16A Switch Module Specifications

Applicable Model:
VX/SW-12/16A

KNX/EIB Residential and building intelligent control system

Product Features


- Manual control switch
- Time function: delay on/off time
- Scene, Preset Controls:5bit/1bit
- With “and”, “or” “and or”, gate function and other logic functions
- Status value query reply
- Mandatory operation, safety function
- Threshold function
- Control of Electrothermal Valve Driver
- Relay switch position selection after bus voltage disconnection and recovery
- Output negated
- Stair lighting function with early warning and adjustable stair lighting time

Equipment operation does not require additional supply voltage, directly via EIB/KNX Bus powered.

Technical paramete.


| | | |
|----------------------------|---|--|
| Power output normal value | - Operating Voltage | 21~30V DC, provided by bus |
| | - Type | 1216.1 |
| Output switch current | —The number of outputs | 12 |
| | — Unrated voltage | 250V/440V AC (50~60Hz) |
| | - meets theAC1(EN60947-4-1) (resistive load) | 20A/230V |
| | - meets theAC3(EN60947-4-1) (capacitive load) | 16A/230V |
| | - meets theEN60669load of fluorescent lamps | 16A/230V |
| Connection | — EIB/KNX | Bus connection terminal (diameter0.8mm) |
| | — Load output connection terminal | screw terminal |
| | — Cable cross section | single core0.2—6.0mm ² |
| Operation and Instructions | — Contact position indication | Multi-core0.2—4mm ² Contact closed - channel open Contact Released - Channel Closed |
| | - Red led and keys | Allocate physical addresses Indicates that the device application layer is working properly |
| | - Green led flicker | |
| | Temperature range | —Run |
| environmental conditions | - Storage | - 25 °C ... + 55 °C |
| | - Transportation | - 25 °C ... + 70 °C |
| | — Humidity | <93%, Except for condensation |
| design | — DIN Rail Module Assembly | 35mmDing rail, modular installation |
| CE standard Certification | - Meets the EMC and low voltage standards, EN50 090-2-2 | |
| | — EIB/KNX Certification | |

Dimensions

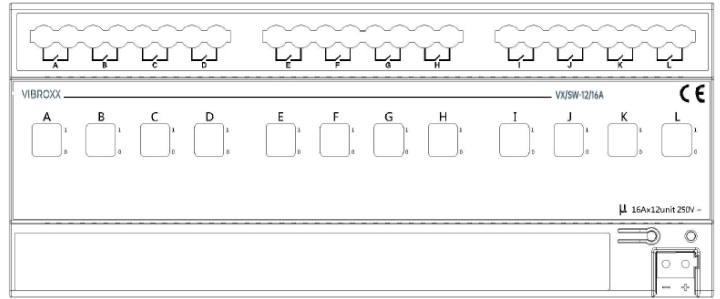

| Model | Size | Weight |
|--------------|-----------------|--------|
| VX/SW-12/16A | 216 x 90 x 64mm | 0.65kg |

Wiring diagram

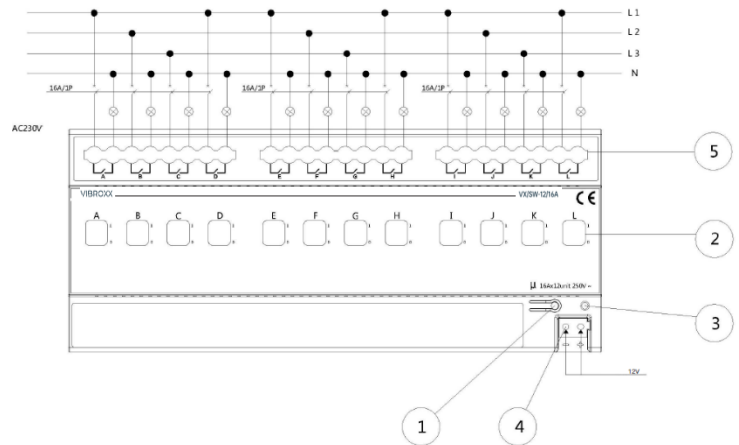

Instruction

- ① Program button
- ② Manual operation switch
- ③ Red led indicates entering physical address programming state, green led blinks to indicate that the device application layer is working
- ④ EIB/KNX bus connection terminal
- ⑤ Input, output and load terminals

Installation Notes

In order to facilitate and quickly install this equipment into the distribution box or small box, according to EN 60715The series is designed as a modular installation device that can be installed in35mm on the Din rail. Installation must ensure that the equipment is operated, tested, inspected, maintained and repaired correctly.

Important hint

Installation and commissioning of equipment should only be performed by qualified and skilled electricians. During planning and implementation of electrical installations relevant standards, directives, rules and instructions are strictly enforced.

- Devices need to be protected from moisture, dirt, and damage during transportation, storage, and use.
- Do not operate the device outside of specified specifications (such as temperature range).
- The device can only be operated in a closed environment (such as a distribution box).

When the equipment is dirty, only use a dry cloth to clean it. If this is not enough to clean, you can gently wipe with a damp cloth with soap solution, never use alkaline agents or corrosive solvents.